



Emergency Preparedness Plan Template

For All Affected Utilities Except Fort Bend and Harris Counties

Assistance

If you need assistance with the EPP template, please fill out the **EPP Help Form** at www.tceq.texas.gov/goto/epp-help and TCEQ will contact you via email or phone to work with you.

General Instructions

- On page 1 complete "General Information" table, circle the option(s) chosen, answer the questions, and sign the certification.
- Complete sections I, II, read section III, in section IV complete the option(s) chosen that apply to your affected utility, and complete Section V as applicable to your affected utility (county judge and sheriff's office information are required).
- Attachments A explains the EPP submittal and distribution requirements, and attachments B - D do not have to be filled out but are supplemental information to assist you in the event of an emergency.

General Information

Water System Name:	Beech Wood Water Supply Corporation
PWS ID No. (if applicable):	TX2020014
District No. (if applicable):	11890
County:	Sabine
CCN No. (if applicable):	
Owner:	Member Owned
Prepared by:	Michelle Brown
Preparer's Phone No.:	409-579-3926
Preparer's Email:	Beech@windstream.net
Preparer's Mailing Address:	5137 Fairdale Rd, <i>Hempill TX 75948</i>
Preparer Title:	Office Manager
Preparer's Organization:	Beech wood Water Supply Corporation
Expected Completion Date for EPP Plan Implementation:	08/20/2026

Option(s) Chosen:


- Refer to Section III-ALTERNATE POWER OPTIONS OVERVIEW.

Circle all Option(s) that will provide emergency operations during extended power outages lasting more than 24 hours for this affected utility.

☒ 1A 2A 2B 3A 3B 4 5 6 7 8A 8B 9 10A 10B 11 12 13 14

- Short Explanation of Proposed Emergency Preparedness Plan (i.e., *Using portable generator to power 2 out of 3 wells*): During power outage, the automatic switch gear will transfer to generator
- Will this plan provide for 20 pounds per square inch (psi) of pressure to all your direct customers during a power outage lasting more than 24 hours caused by a natural disaster? YES
- Is a timeline to implement the plan (TWC 13.1394(b)(2)(B)) provided as an attachment? No already implemented

I certify, under penalty of law, that all the information provided herein is true and accurate to the best of my knowledge.

Signature:  Title Office Manager

Date 08/20/2026

UPDATES TO EMERGENCY PREPAREDNESS PLAN (EPP)

The EPP is updated as changes occur such as dictated by personnel, phone numbers, water plant additions, modifications, and serving additional water systems.

Record updates below:

Last Updated By	Title	Purpose (page #s)	On (Date)

SECTION I – INTRODUCTION

1. APPLICABILITY

This emergency preparedness plan template was developed for the operators and administrators of affected utilities to comply with the requirements for "affected utilities" in Texas Water Code, Section 13.1394 as required by Senate Bill 3 (SB 3) and to demonstrate the affected utility's ability to provide emergency operations during extended power outages lasting **more than 24 hours**.

An **affected utility** is a retail public utility, exempt utility, or provider or conveyer of potable or raw water service that furnishes water service to more than one customer, provides overnight accommodations, and **is not** an affected utility under Texas Water Code, Section 13.1395. An **extended power outage** means a power outage lasting more than 24 hours.

If you believe that you are NOT an affected utility please email PDWEPP@tceq.texas.gov to ensure that the requirements do not apply to the water system.

A. Describe Your Water System. Check all that apply.

☒ Residential Commercial Industrial Wholesale Institution

B. Is This EPP For An ☒ Existing or Proposed Water System?

2. CONTACT INFORMATION

During any type of emergency, the following person(s) will be responsible for the water system (contact will be attempted in the order indicated):

Name	Title in the Organization	E-mail	Office Phone Number	Cell Phone Number	Home Phone Number	Other Phone Number
Billy Manley	Manager	Bm5541@yahoo.com	409-579-3926	409-659-8941		
Jonathan Isgitt	Operator	Beech@windstream.net	409-579-3926	409-339-9009		
Michelle Brown	Office manager	michelle@beechwoodinfo.com	409-579-3926	936-201-6681		
Kipp Findley	Board member			409-718-1681		

3. Location of Maps

The maps are not required to be submitted to TCEQ for review of the EPP but should be available in case of an emergency to enable staff to locate valves, lines, and meters.

Where are your distribution system(s) map(s) located? In office

4. Diagram of Water System

Submit a diagram of your drinking water system that shows all equipment (source(s), tank(s), pumps), treatment chemicals, and any open or closed interconnects with other water systems.

Beechwood WSC
PWS ID#: 2020014

Marissa Peltier 9/13/2021

I/C with South Sabine WSC
(PWS ID 2020070)
4.5 MG/month

M

Generator

Ground Storage Tanks


0.230
MG

0.0335
MG

0.0335
MG *

*Please note that one of the 0.033 MG
Ground storage tanks has not been used
for the past several years.

Service Pumps
(2) at 400 GPM



Pressure Tanks
5,000 gal
5,000 gal

Distribution System
512 Connections

Section II – DESCRIPTION OF THE WATER SYSTEM

IMPORTANT: Include only the equipment located at your water system, not the equipment located at another water system unless two or more systems rely on each other during an emergency, and it is documented in a contract or written agreement.

1. SOURCE INFORMATION

A. Groundwater Systems - Does Your Water System Have A Ground Water Well(s)?

YES ☐ NO ☒ (If NO, go to 1.B)

TCEQ Source ID	Owner's Designation	Well Location	Used During an Emergency?	What plant name is this source associated with?	Pump Capacity
			YES ☐ NO ☐		gpm
			YES ☐ NO ☐		gpm
			YES ☐ NO ☐		gpm

B. Surface Water/GUI Systems: Does Your Water System Treat Surface Water or Ground Water Under the Influence of Surface Water Sources(s) (raw water intake pump information)?

YES ☐ NO ☐ (If NO, go to 1.C)

TCEQ Source ID	Owner's Designation	Intake Location	Used During an Emergency?	Number of Pumps	What plant name is this source associated with?	Total Pump Capacity at Intake
			YES ☐ NO ☐			gpm
			YES ☐ NO ☐			gpm
			YES ☐ NO ☐			gpm

C. Does Your Water System Purchase (or Receive) Water?

YES ☐ NO ☐ (If NO, go to 2.A)

- i. Is this affected utility a direct pressure system? (Does the provider's water flow directly into your distribution system, not into a tank? Direct pressure systems generally have no tanks or pumps.)

YES ☒ NO ☐

- ii. Does this affected utility re-pressurize the water received from the provider? (Does the water from the provider flow into a tank which is then pumped out into the distribution system by your **own** pumps?) Only provide added pressure when needed.

YES ☒ NO ☐

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

Provider Name	PWS ID	Pressure Plane (if more than 1 plane)	Will You Rely on This Provider for Water During an Emergency?	Will You Rely on This Provider for Pressure at Your Customer's Connections During an Emergency?	Capacity	Normally Open or Closed Interconnect?
SOUTH SABINE WSC	TX202075	PRESSURE PLANE 1	YES ☒ NO ☐	YES ☒ NO ☐	104 gpm	OPEN
			YES ☐ NO ☐	YES ☐ NO ☐	gpm	
			YES ☐ NO ☐	YES ☐ NO ☐	gpm	

2. TREATMENT INFORMATION

A. Does Your Water System Disinfect the Water?

YES ☐ NO ☒ (If NO, go to 2.B)

Disinfectant (Disinfectant Name)	Location (Plant Name)	Disinfectant Used During an Emergency?	Type of Disinfectant (Liquid/Gas)	Volume Stored (gals or lbs.)	Days of Storage (Emergency Demand)	Electricity Required to Feed Disinfectant?
		YES ☐ NO ☐				YES ☐ NO ☐
		YES ☐ NO ☐				YES ☐ NO ☐
		YES ☐ NO ☐				YES ☐ NO ☐

B. Does Your Water System Provide Treatment Other Than Disinfection (example: polyphosphate, caustic etc.)?

YES ☐ NO ☒ (If NO, go to 2.C)

Chemical Feed Pump (Chemical Feed Name)	Location (Plant Name)	Chemical Used During an Emergency?	Type of Chemical (Liquid/Gas)	Volume Stored (gals or lbs.)	Days of Storage (Emergency Demand)	Electricity Required to Feed Chemical
		YES ☐ NO ☐				YES ☐ NO ☐
		YES ☐ NO ☐				YES ☐ NO ☐
		YES ☐ NO ☐				YES ☐ NO ☐

C. Does Your Water System Have Transfer Pump(s) Between Treatment Units? These are the pumps located within the treatment processes of your treatment Plant(s).

(Do not include well or intake pumps)

YES ☐ NO ☒ (If NO, go to 3.A)

In-Plant Transfer Pump Name	Location (Plant Name)	Pump Used During an Emergency?	Pump Capacity
		YES ☐ NO ☐	gpm
		YES ☐ NO ☐	gpm
		YES ☐ NO ☐	gpm

3.

CONFIDENTIAL
Not subject to disclosure under Chapter 552, Government Code

4. DISTRIBUTION SYSTEM INFORMATION

A. Does Your Water System Have Booster and/or Service Pumps in the Distribution system?

YES ☒ NO ☐ (If NO, go to 3.B)

Booster/Service Pump Name	Location (include pressure plane)	Pump Used During an Emergency?	Pump Capacity
BOOSTER PUMP 1	PLANT 1	YES ☒ NO ☐	400 gpm
BOOSTER PUMP 2	PLANT 1	YES ☒ NO ☐	400 gpm
		YES ☐ NO ☐	gpm

D. Does Your Water System Have Any Finished Water Storage/Pressurization Tanks?

YES ☒ NO ☐ (If NO, go to 4.A)

Tank Type (Elevated, Hydropneumatic, Ground or Standpipe)	Location (include pressure plane)	Tank Used During an Emergency?	Tank Capacity
GROUND STORAGE TANK 1	PLANT 1	YES ☒ NO ☐	230,000 gal
GROUND STORAGE TANK 2	PLANT 1	YES ☒ NO ☐	33,500 gal
PRESSURE TANK 1	PLANT 1	YES ☐ NO ☒	5,000 gal
PRESSURE TANK 2	PLANT 1	YES ☐ NO ☒	5,000 gal
		YES ☐ NO ☐	gal

5. PRESSURE PLANES

Does Your Water System Have More Than One Pressure Plane?

YES ☐ NO ☒ (If NO, go to 5)

Pressure Plane	TCEQ Source ID(s) or Provider PWS ID(s)	Plant Names(s) (If Applicable)	Pump Names(s) (If Applicable)

6. SYSTEM DEMAND

Emergency Operation means the demand in MGD from the highest emergency usage day (not normal daily usage) occurring during a natural disaster within the last 3 years, excluding fire events and large water main breaks.

Demand Information	Normal Operation	Emergency Operation
Average Daily Demand:	.0425 MGD	.086 MGD
Maximum Daily Demand:	.0125 MGD	.0200 MGD
System Capacity:	.565 MGD	.6 MGD

7. SYSTEM SIZE

A. Does Your Water System Sell/Provide Water to Other Water Systems?

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

YES ☐ NO ☒ (If NO, go to 6.B)

Receiver/Buyer Name	PWS ID (if applicable)	Will you provide "water only" to this Receiver During an Emergency?	Will You Provide 20 psi to the Receiver's Distribution System During an Emergency?	Capacity in GPM sold to Receiver on daily basis	Number of Connections in the Receiver's Water System	Normally Open or Closed Interconnect ?
		YES ☐ NO ☐	YES ☐ NO ☐			
		YES ☐ NO ☐	YES ☐ NO ☐			
		YES ☐ NO ☐	YES ☐ NO ☐			

E. Number of Connections and Population in Each Pressure Plane in Your Water System?

(If applicable, include any connections from other water systems you may serve in the table in 6.A)

Pressure Plane (if applicable)	Number of Connections	Population
PRESSURE PLANE 1	513	1,187

8. POWER PROVIDER(s)

Electric Utility or Retail Electrical Provider(s)	DEEP EAST TEXAS CO-OP
---	-----------------------

9. ELECTRICAL SCHEMATIC

Provide an electrical schematic or diagram of your water system's emergency power facilities and the equipment (treatment(s), supply, pressure maintenance, etc.) that is powered. **SEE ATTACHMENT**

10. OTHER PERTINENT SYSTEM INFORMATION

Other information about the system that could be useful during an emergency or that will add clarity to your EPP. (This can include plant equipment not used or any other circumstances that would clarify how the affected utility will meet the EPP requirements):

--

Section III– Alternate Power Options Overview

The following is a list that will assist in determining which option (or options) should be selected to demonstrate the ability to provide emergency operations during extended power outages lasting more than 24 hours. Provide the required information on the following applicable pages. You must select at least one option and **options (7-13) may require more than one option.**

OPTION 1: PERMANENTLY INSTALLED AUTOMATIC STARTING AUXILIARY GENERATOR(S)

COMPLETE OPTION 1 – Sections A through C

OPTION 2A: YOUR SYSTEM WILL RELY ON YOUR PROVIDER DURING AN EXTENDED POWER OUTAGE

The type of systems that will utilize this option are a distribution only system which receives water under direct pressure relying on their provider for water at 20 psi throughout their distribution system. A water system receives water to a tank and re-pressurizes the water to maintain 20 psi in their distribution system may also choose this option. Choose if you will rely on a water provider *during an extended power outage.*

COMPLETE OPTION 2A – Sections A and B

OPTION 2B: MEMBER OF TXWARN

A “**distribution only**” system may only use this option if it needs certified staff for operational purposes or needs equipment to repair their distribution system. A **distribution only system** will need to choose Option 2A for the purpose of maintaining 20 psi in its distribution system during an extended power outage.

COMPLETE OPTION 2B – Sections A through B

OPTION 3A: NEGOTIATION OF LEASING AND CONTRACTING AGREEMENTS

Your facility has obtained a leasing or contract agreement for emergency power equipment and fuel. The agreement(s) must provide for coordination with the Texas Division of Emergency Management.

COMPLETE OPTION 3A – Sections A through D

OPTION 3B: MUTUAL AID AGREEMENT(S) WITH OTHER WATER PROVIDERS

Your facility is a member of another mutual aid provider, you have identified, and will make available one or more resources with another mutual aid provider. Your facility has obtained mutual aid agreement(s) for emergency power equipment and fuel with other water providers including retail, exempt, potable, or raw water providers. The agreement(s) must provide for coordination with the Texas Division of Emergency Management.

COMPLETE OPTION 3B – Sections A through B

OPTION 4: USE OF PORTABLE GENERATOR(S) CAPABLE OF SERVING MULTIPLE FACILITIES EQUIPPED WITH QUICK-CONNECT SYSTEMS

A portable generator capable of being moved to serve multiple facilities where both the portable generator and facilities are equipped with compatible quick-connect systems.

COMPLETE OPTION 4 – Sections A through D

OPTION 5: USE OF ON-SITE ELECTRICAL GENERATION OR DISTRIBUTED GENERATION FACILITIES

On-site electrical generation or distributed generation facilities. On-site electrical generation means that each facility generates, or can generate, its own power rather than being powered by a commercial electric power grid. Distributed Generation Facilities are small-scale power producing facilities located near the electrical load, which may feed into a common grid. An example is electricity generated by solar power.

COMPLETE OPTION 5 – Sections A through D

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 6: HARDENING THE ELECTRIC TRANSMISSION AND DISTRIBUTION SYSTEM SERVING THE WATER SYSTEM

One alternative is to relocate electric transmission lines for the system from overhead to underground and protect them from strong winds. Another alternative is to replace overhead transmission lines, poles and rated appurtenances with ones that can withstand historical hurricane-force wind velocities, and trim or remove any trees or branches next to and above the overhead transmission lines.

COMPLETE OPTION 6 – Sections A and B

OPTION 7: USE AND MAINTENANCE OF DIRECT ENGINE OR RIGHT-ANGLE DRIVES

Direct engine or right-angle drive. This option is only available to existing facilities, **may** require more than one option, and must still provide 20 psi throughout the distribution system.

COMPLETE OPTION 7 – Sections A through C

OPTION 8A: DESIGNATION OF THE WATER SYSTEM AS A CRITICAL LOAD FACILITY

Your water system is registered with your electric provider as a critical load facility, this **will** require more than one option, and must provide 20 psi throughout the distribution system (see page 19 for additional information on the requirement for a second option). Will require documentation from your electric provider indicating your facility is protected from power loss lasting more than 24 hours.

COMPLETE OPTION 8 – Sections A and B

OPTION 8B: RECOGNITION OF THE WATER SYSTEM AS HAVING REDUNDANT, ISOLATED, OR DEDICATED ELECTRICAL FEEDS

Your water system has redundant, isolated, or dedicated electrical feeds to water plant(s) and equipment, this **will** require more than one option, and must provide 20 psi throughout the distribution system (see page 21 for additional information on the requirement for a second option). Will require documentation from your electric provider indicating your facility is protected from power loss lasting more than 24 hours.

COMPLETE OPTION 8B – Sections A and C

OPTION 9: PROVIDE WATER STORAGE CAPABILITIES

Your water system has sufficient ground, elevated, or standpipe storage to provide your entire distribution system with water at 20 psi during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option.

COMPLETE OPTION 9 – Sections A and E

OPTION 10A: WATER IS DELIVERED TO YOUR DISTRIBUTION SYSTEM FROM OUTSIDE YOUR SERVICE AREA USING AN EMERGENCY INTERCONNECT

Water is delivered from outside your service area in such a manner that you can provide water at 20 psi to your distribution system during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option.

COMPLETE OPTION 10 – Sections A and F

OPTION 10B: WATER IS DELIVERED TO YOUR DISTRIBUTION SYSTEM FROM OUTSIDE YOUR SERVICE AREA USING A WATER HAULER

Water is delivered from outside your service area in such a manner that you can provide water at 20 psi to your distribution system during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option.

COMPLETE OPTION 10 – Sections A and H

OPTION 11: WATER SYSTEM HAS THE ABILITY TO PROVIDE WATER THROUGH ARTESIAN FLOWS

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

An affected utility can provide water using an approved artesian source to their distribution system at 20 psi during an extended power outage lasting more than 24 hours. This option **will** need to be combined with another option (see page 28 for additional information on the requirement for a second option).

COMPLETE OPTION 11 – Sections A and E

OPTION 12: REDUNDANT INTERCONNECTIVITY BETWEEN PRESSURE ZONES

An affected utility opens valves in one or more pressure zones within their water system to provide water at 20 psi in all pressure zones throughout its entire distribution system during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option.

COMPLETE OPTION 12 – Sections A and D

OPTION 13: USE EMERGENCY WATER DEMAND RULES TO MAINTAIN EMERGENCY OPERATIONS

An affected utility will provide a minimum of 0.35 gallons per minute (gpm) per connection to the distribution system while maintaining distribution pressures of at least 20 psi in the event of the loss of normal power supply. This option **will** need to be combined with other option(s) to ensure 20 psi during a water outage lasting more than 24 hours (see page 30 for additional information on the requirement for a second option).

COMPLETE OPTION 13 – Sections A and D

OPTION 14: ANY OTHER ALTERNATIVE DETERMINED BY THE COMMISSION TO BE ACCEPTABLE

An affected utility can propose other alternatives of meeting the requirements of TWC 13.1394 if the alternative(s) ensure water will be provided at 20 psi throughout the distribution system during a water outage lasting more than 24 hours.

COMPLETE OPTION 14 – Sections A and B

Section IV– Alternate Power Options Details

OPTION 1: PERMANENTLY INSTALLED AUXILIARY GENERATOR(S)

A. Generator Specifications.

Please list all the generators, all equipment to be powered, and the power needs for each piece of equipment.

Generator Brand & Model	Max Power (KW)**	Phase	Fuel Type	Automatic Switch Gear?	Facility Staffed 24 hours a day, 7 days a week?	List all Facilities and Treatment Units That Will Be Powered During an Emergency	Power Requirements for Each Facility and Treatment Unit Powered**
GENERAC Gbu43	150	1 ☐	PROPANE	YES ☒	YES ☐	Well pump 1 ☐	kW
		2 ☐		NO ☐	NO ☒	Well pump 2 ☐	kW
		3 ☒				Well pump 3 ☐	kW
						Booster pump 1 ☒	19 kW
						Booster pump 2 ☒	19 kW
						Booster pump 3 ☐	kW
						Disinfection Equipment ☐	kW
						Treatment Equipment ☐	kW
						Compressor(s) ☒	8kW
							☐
		1 ☐		YES ☐	YES ☐		kW
		2 ☐		NO ☐	NO ☐		kW
		3 ☐					kW
		1 ☐		YES ☐	YES ☐		kW
		2 ☐		NO ☐	NO ☐		kW
							kW
		3 ☐					kW

**The generator's total KWs cannot be less than the KWs listed under the power requirements for each facility and treatment unit that will be provided power. The generator must be able to power the equipment listed by the water system. **

F. Fuel Location

- i. Physical Location of Fuel Supply (GPS or "911" address): 5137 FAIRDALE ROAD, HEMPHILL, TX 75948

G. Fuel Re-supply. Must have sufficient fuel to provide emergency power for a minimum of 48 hours or more if needed based on past power outages and utility knowledge.

- i. How much fuel is stored on site? 1,000 GAL

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

- ii. How much fuel does the generator use per hour? (Attachment **B** may assist in determining that amount) 3 GAL
- iii. Does the water system have access to additives/other methods to prevent fuel from freezing as per manufactures recommendations (example diesel additives)? NONE NEEDED

CONFIDENTIAL
Not subject to disclosure under Chapter 552, Government Code

OPTION 2A: YOUR SYSTEM WILL RELY ON YOUR PROVIDER DURING AN EXTENDED POWER OUTAGE

Choose only if you will rely on purchased water as your source to provide 20 psi to your customer's connections during an extended power outage (emergency operations). You are required to provide written documentation as described below to be able to use this option.

Provider Name	PWS ID	PRESSUR E PLANE	In an emergency, will water from this provider go to a tank?	In an emergency, will you rely on this provider for pressure at 20 psi to YOUR customer's connections?
			YES ☐ NO ☐	YES ☐ NO ☐
			YES ☐ NO ☐	YES ☐ NO ☐
			YES ☐ NO ☐	YES ☐ NO ☐

A. Is your water system solely relying on a provider(s) for emergency operations? (This means, the provider's water flows directly into your distribution system, and not into a tank, you have no tanks or pumps, and your provider is also providing 20 psi of pressure in your distribution system.)

☐ **YES (If yes, you must submit documentation under 2A.i. listed below.)**

☐ **NO (Please fill out the pages for the alternative power option that will power the equipment)**

i. Please provide **one or more** of the following:

☐ A copy of the contract(s) with your provider(s) that includes language guaranteeing 20 psi throughout your distribution system or specific pressure plane. Please tab the page and highlight the section in the contract guaranteeing pressure.

☐ A letter from the provider(s) including language guaranteeing 20 psi throughout your distribution system or specific pressure plane.

☐ Page(s) from the provider's EPP which includes the connection count for your system (or pressure plane) in the provider's connection count.

☐ An engineering study (hydraulic analysis) sealed by a Texas Licensed Professional Engineer demonstrating that the provider is capable, of providing your entire distribution system with water services at a minimum of 20 psi.

ii. Does your water system operate any equipment such as booster disinfection that will need power during an emergency?

☐ **YES (Please fill out the pages for the alternative power option that will power the equipment)**

☐ **NO**

H. Is your water system solely relying on *water only* from your provider(s) into a tank and your water system will be re-pressurizing the water received from the provider? (This means the water from the provider flows into a tank which is then pumped out into the distribution system by your **own pumps. Your water system is not relying on the provider for pressure.)**

☐ **YES (If yes, you must submit documentation under 2.B.i. listed below and fill out the pages for the alternative power option(s) that will power the re-pressurization equipment.)**

☐ **NO**

i. Please provide **one or more** of the following:

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

☐ A copy of the contract(s) with your provider(s) that includes language guaranteeing your water system with water. Please tab the page and highlight the section in the contract guaranteeing water.

☐ A letter from the provider(s) which includes language guaranteeing water to your water system or specific pressure plane.

☐ Page(s) from the provider's EPP which includes the connection count for your system (or pressure plane) in the provider's connection count.

ii. Does your water system operate any equipment such as booster disinfection that will need power during an emergency?

☐ **YES** (Please fill out the pages for the alternative power option that will power the equipment)

☐ **NO**

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 2B: CONTRIBUTING MEMBER OF TXWARN

Member has identified needed resource(s) to the TXWARN system. Installation of a quick connect system is required with this option. A **"distribution only" system may not use this option to maintain 20psi in distribution**. A distribution only system is defined as a system that receives treated water from another entity and does not maintain storage or pressure facilities.

A. Please provide ALL of the following items

- ☐ A copy of the TXWARN membership profile page.
- ☐ A copy of the mutual aid agreement with TXWARN (Applicable to Investor/Private Owned Water systems)
- ☐ A local government entity is covered by the Texas Statewide Mutual Aid System as stated in the Texas Government Code Section 418.111 Subchapter E (Applicable to Cities, Counties, and Districts)

I. Generator specifications

Please list the items hoped to be obtained from TXWARN. List **all** equipment to be powered, and the power needs for each piece of equipment.

Generator	Power (KW)	Quick Connect Installed?	Phase	List all Facilities and Treatment Units That Will Be Powered During an Emergency	Power Requirements of Each Facility and Treatment Unit Powered	
		YES ☐	1 ☐	Well pump 1 ☐	kW	
		NO ☐	2 ☐	Well pump 2 ☐	kW	
				Well pump 3 ☐	kW	
				Booster pump 1 ☐	kW	
					Booster pump 2 ☐	kW
					Booster pump 3 ☐	kW
				Disinfection Equipment ☐	kW	
				Treatment Equipment ☐	kW	
				Compressor(s) ☐	kW	
				☐	kW	
						YES ☐
NO ☐	2 ☐		kW			
			kW			
			kW			
			kW			
			kW			
			kW			
			kW			
			kW			
			kW			
			kW			

****The generator's total KWs cannot be less than the KWs listed under the power requirements for each facility and treatment unit that will be provided power. The generator must be able to power the equipment listed by the water system. ****

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 3A: NEGOTIATION OF LEASING AND CONTRACTING AGREEMENTS

Your water system will obtain an agreement with a generator providing company. Installation of a quick connect system is required with this option. Please note that the agreement must provide for coordination with the Texas Division of Emergency Management.

A. Provide a signed copy of the agreement

J. Generator Specifications

Please list the generator to be leased, all equipment to be powered, and the power needs for each piece of equipment.

Generator Brand & Model	Max Power (KW)	Phase	Quick Connect Installed ?	Fuel Type	List all Facilities and Treatment Units That Will Be Powered During an Emergency	Power Requirements for Each Facility and Treatment Unit Powered
		1 ☐	YES ☐		Well pump 1 ☐	kW
		2 ☐ 3 ☐	NO ☐ Date to be installed		Well pump 2 ☐	kW
					Well pump 3 ☐	kW
					Booster pump 1 ☐	kW
					Booster pump 2 ☐	kW
					Booster pump 3 ☐	kW
					Disinfection Equipment ☐	kW
					Treatment Equipment ☐	kW
					Compressor(s) ☐	kW
					☐	kW
		1 ☐	YES ☐			kW
		2 ☐ 3 ☐	NO ☐ Date to be installed			kW
						kW
						kW
		1 ☐	YES ☐			kW
		2 ☐ 3 ☐	NO ☐ Date to be installed			kW
						kW
						kW
**The generator's total KWs cannot be less than the KWs listed under the power requirements for each facility and treatment unit that will be provided power. The generator must be able to power the equipment listed by the water system. **						

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

K. Fuel Location

- i. Physical Location of Fuel Supply (GPS or "911" address):

L. Fuel Re-supply. Must have sufficient fuel to provide emergency power for a minimum of 48 hours or more if needed based on past power outages and utility knowledge.

- i. How much fuel is stored on site?
- ii. How much fuel does the generator use per hour? (Attachment B may assist in determining that amount.)

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 3B: MUTUAL AID AGREEMENT WITH ANOTHER WATER PROVIDER(S)

Member has identified needed resource(s) to another water provider as part of a mutual aid agreement. Installation of a quick connect system is required with this option. A **“distribution only” system may not use this option to maintain 20psi.** Please note that the agreement must provide for coordination with the Texas Division of Emergency Management.

A. Please provide ALL of the following items:

- ☐ Name of water system(s) or group that you have a mutual aid agreement with.
- ☐ A copy of the mutual aid agreement from each water provider.
- ☐ Highlight the area in the agreement that lists the resource(s) to be provided by the water system(s).

M. Generator specifications

Please list the items that are anticipated to be obtained through a mutual-aid agreement. List **all** equipment to be powered, and the power needs for each piece of equipment.

Generator Brand & Model	Max Power (KW)	Phase	Quick Connect Installed?	Fuel Type	List all Facilities and Treatment Units That Will Be Powered During an Emergency	Power Requirements for Each Facility and Treatment Unit Powered
		1 ☐	YES ☐		Well pump 1 ☐	kW
		2 ☐	NO ☐		Well pump 2 ☐	kW
					Well pump 3 ☐	kW
					Booster pump 1 ☐	kW
					Booster pump 2 ☐	kW
					Booster pump 3 ☐	kW
					Disinfection Equipment ☐	kW
					Treatment Equipment ☐	kW
					Compressor(s) ☐	kW
					☐	kW
		1 ☐	YES ☐			kW
		2 ☐	NO ☐			kW
						kW
					3 ☐	Date to be installed
		1 ☐	YES ☐			kW
		2 ☐	NO ☐			kW
						kW
					3 ☐	Date to be installed

****The generator's total KWs cannot be less than the KWs listed under the power requirements for each facility and treatment unit that will be provided power. The generator must be able to power the equipment listed by the water system. ****

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 4: USE OF PORTABLE GENERATOR(S) CAPABLE OF SERVING MULTIPLE FACILITIES EQUIPPED WITH QUICK-CONNECT SYSTEM(S)

- A. Please list the storage location of the portable generator. If sharing the generator, list the name of the water system you are sharing with and their location.**

Generator Brand & Model	Generator Storage Location	Distance from Your Water System	Other Water Systems Sharing This Generator (PWS Name and ID if applicable)	Distance Between Your Water System and Those Sharing the Generator

N. Generator specifications

Please list **all** the portable generators, **all** equipment to be powered, and the power needs for each piece of equipment.

Generator Brand & Model	Max Power (KW)	Phase	Fuel Type	Quick Connect Installed?	List all Facilities and Treatment Units That Will Be Powered During an Emergency	Power Requirements for Each Facility and Treatment Unit Powered
		1 ☐		YES ☐	Well pump 1 ☐	kW
		2 ☐		NO ☐	Well pump 2 ☐	kW
		3 ☐		Date to be installed	Well pump 3 ☐	kW
					Booster pump 1 ☐	kW
					Booster pump 2 ☐	kW
					Booster pump 3 ☐	kW
					Disinfection Equipment ☐	kW
					Treatment Equipment ☐	kW
					Compressor(s) ☐	kW
					☐	kW
		1 ☐		YES ☐		kW
		2 ☐		NO ☐		kW
		3 ☐		Date to be installed		kW
						kW

O. Fuel Location (if applicable)

- i. Physical Location of Fuel Supply (GPS or "911" address):

- P. Fuel Re-supply. Must have sufficient fuel to provide emergency power for a minimum of 48 hours or more if needed based on past power outages and utility knowledge.**

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

- i. How much fuel is stored on site?
- ii. How much fuel does the generator use per hour? (Attachment B may assist in determining that amount.)

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 5: USE OF ON-SITE ELECTRICAL GENERATION OR DISTRIBUTED GENERATION FACILITIES

Onsite Electrical Generation means that each facility generates its own power rather than being powered by a commercial electric power grid. Distributed Generation Facilities are small-scale power producing facilities located near the electrical load which may feed into a common grid.

A. On-Site Electrical Generation or Distributed Generation Specifications

- i. Describe On-Site Electrical Generation or Distributed Generation Facility:

Q. On-site Electrical Generation or Distributed Generation Specifications

Please list all facilities, list all equipment to be powered and the power needs for each piece of equipment.

Type of On-site Electrical Generation Facilities.	Max Power (KW)	Fuel Type (if applicable)	List all Facilities and Treatment Units That Will Be Powered During an Emergency	Power Requirements of Each Facility and Treatment Unit Powered
			Well pump 1 ☐	kW
			Well pump 2 ☐	kW
			Well pump 3 ☐	kW
			Booster pump 1 ☐	kW
			Booster pump 2 ☐	kW
			Booster pump 3 ☐	kW
			Disinfection Equipment ☐	kW
			Treatment Equipment ☐	kW
			Compressor(s) ☐	kW
			☐	kW
				kW
				kW
				kW
				kW
				kW

R. Fuel Location

- i. Physical Location of Fuel Supply (GPS or "911" address):

S. Fuel Re-supply. Must have sufficient fuel to provide emergency power for a minimum of 48 hours or more if needed based on past power outages and utility knowledge.

- i. How much fuel is stored on site?
 ii. How much fuel does the generator use per hour? (Attachment B may assist in determining that amount)

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

**OPTION 6: HARDENING THE ELECTRIC TRANSMISSION AND DISTRIBUTION SYSTEM
SERVING THE WATER SYSTEM**

One alternative is to relocate electric transmission lines for the system from overhead to underground and protect them from flooding. Another alternative is to replace overhead transmission lines, poles and rated appurtenances with ones that can withstand historical hurricane-force wind velocities, and trim or remove any trees or branches next to and above the overhead transmission lines.

A. Hardening Description

- i. Describe the hardening activities:

T. Diagram

Include a diagram showing the electrical system, including the power transmission system (from the power generation facility to the customer's power meter) and distribution system (the water system's electrical wiring after the customer's power meter) feeding each water facility and the preventive measures taken for each.

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 7: USE AND MAINTENANCE OF DIRECT ENGINE OR RIGHT- ANGLE DRIVES

(EXISTING FACILITIES ONLY) This option is only available to existing facilities and, **may** require more than one option. If right angle drive is located only on a well how will treated water be sent to the distribution system or if located only on a booster pump, how is treated water entering a storage tank, and must still provide 20 psi throughout the distribution system.

A. Direct Engine or Right-Angle Drive Specification

Please list all the drives, all equipment to be powered, and the power needs for each piece of equipment.

Brand or Model	Max Power (HP, kW)	RPM	Fuel Type	List all Facilities and Treatment Units Powered	Power Requirements of Each Facility and Treatment Unit Powered (circle appropriate unit)
				Well pump 1 ☐	kW or HP
				Well pump 2 ☐	kW or HP
				Well pump 3 ☐	kW or HP
				Booster pump 1 ☐	kW or HP
				Booster pump 2 ☐	kW or HP
				Booster pump 3 ☐	kW or HP
				Disinfection Equipment ☐	kW or HP
				Treatment Equipment ☐	kW or HP
				Compressor(s) ☐	kW or HP
				☐	kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP
					kW or HP

U. Fuel Location (if applicable)

- i. Physical Location of Fuel Supply (GPS or "911" address):

V. Fuel Re-supply. Must have sufficient fuel to provide emergency power for a minimum of 48 hours or more if needed based on past power outages and utility knowledge.

- i. How much fuel is stored on site?
- ii. How much fuel does the generator use per hour? (Attachment B may assist in determining that amount.)

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 8A: DESIGNATION OF THE WATER SYSTEM AS A CRITICAL LOAD FACILITY

Your water system is registered with your electric provider as a critical load facility. This **will** require more than one option, because designation of critical load does not guarantee an uninterrupted supply of electricity. It is the responsibility of the water system to plan for alternative sources of electric power should a localized outage or load shed event occur. The water system is required to provide 20 psi throughout the distribution system.

A. Provide ALL of the following items for designation of Critical Load Facility.

☐ Name of electric provider(s).

☐ A copy of the letter or email from your electric provider(s) designating your water system as having critical load status.

☐ Submit a diagram of your water system that includes all equipment listed in Section II DESCRIPTION OF THE WATER SYSTEM

☐ Please choose other option(s) to ensure your utility can maintain 20psi if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.

Please provide other option(s) _____ then complete that section of the EPP.

W. Indicate all facilities that are included in critical load status (please refer to the facilities listed for the PWS in Section II – Description of the Water System) and use the exact same naming convention.

Name of Plant	Address to Electric Meter Providing Power to Plant

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 8B: DESIGNATION OF THE WATER SYSTEM AS HAVING REDUNDANT, ISOLATED, OR DEDICATED ELECTRICAL FEEDS

Your water system has redundant, isolated, or dedicated electrical feeds. This **will** require more than one option, because having redundant, isolated, or dedicated electrical feeds does not guarantee an uninterrupted supply of electricity. It is the responsibility of the water system to plan for alternative sources of electric power should a localized outage or load shed event occur. The water system is required to provide 20 psi throughout the distribution system.

A. Provide the following if facility has redundant, isolated, or dedicated electrical feeds

- ☐ Name of electric provider(s) that will provide redundant, isolated, or dedicated electrical feeds.
- ☐ A copy of the letter or email from your electric provider(s) that designates your water system as having redundant, isolated, or dedicated electrical feeds.
- ☐ Submit a diagram of your water system that includes all equipment listed in Section II DESCRIPTION OF THE WATER SYSTEM
- ☐ Please choose other option(s) to ensure your utility can maintain 20psi if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.
- Please provide other option(s) _____ then complete that section of the EPP.

X. Indicate all facilities that are included in having redundant, isolated, or dedicated electrical feeds:

Name of Plant	Address to Electric Meter Providing Power to Plant

Y. Indicate the facilities not included in having redundant, isolated, or dedicated electrical feeds:

Name of Plant	Address to Facility without Dedicated Electrical Feeds

OPTION 9: PROVIDE WATER STORAGE CAPABILITIES

Your water system has sufficient ground, elevated, or standpipe storage to provide your entire distribution system with water at 20 psi during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option if the water system does not have sufficient, useful storage during a power outage lasting longer than 24 hours. It is the responsibility of the water system to plan for alternative sources of electric power should the water system not have sufficient storage to last for greater than 24 hours.

- A. Explain how the water in storage will flow to customers, and how it will be replenished (with or without electricity)?**
- Z. Does the water system have an existing, valid exception or alternative capacity requirement (ACR) for elevated or ground storage capacity? [30 TAC §290.45(g) and or 30 TAC §290.39(l)]**
- ☐ **YES ****
- ☐ **NO**

****** Water systems with an exception or alternative capacity requirement that *is less than*, the required minimum capacity requirements for storage, will be required to choose a different option. A different option is required because an exception or alternative capacity requirement reduces the water system's minimum required treatment capacity and consequently reduces the system's ability to provide useful¹ water storage capacity during an outage lasting more than 24 hours.

Use the diagram on the next page to assist you in answering questions C and D.

- AA. What is the useful storage¹ capacity of all storage tanks that maintain distribution pressures above 20 psi (46 feet of residual hydraulic head above the highest connection)?**

Note: If you have dedicated fire storage, do not include it in the number above.

Useful storage capacity of all storage tanks: _____


- BB. Using the water systems Maximum Daily Demand (MDD) listed in question 5 under Section II – Description of the Water System, divide the useful storage volume (million gallons) for maintaining distribution pressures above 20 psi by the MDD under emergencies. This is the amount of days water can be provided if storage was full before the start of the emergency.**

Number of days water can be provided before a state of emergency arises: _____

- CC. Please choose other option(s) to ensure your utility can maintain 20 psi if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.**

Please provide other option(s) _____ then complete that section of the EPP.

¹ The AWWA Drinking Water Dictionary defines useful storage as "water storage that is readily available for discharge into a distribution system, such as water in an elevated storage tank or in a ground storage tank that can be pumped into the system. Water in a ground storage tank below the suction level of the pump would be storage, but not useful storage".

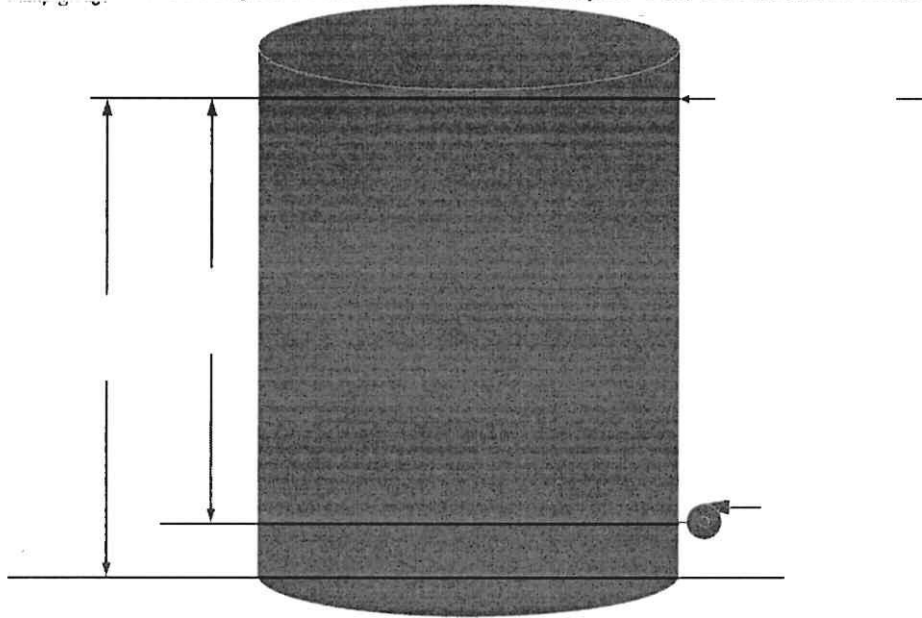

OPTION 10A: WATER IS DELIVERED TO YOUR DISTRIBUTION SYSTEM FROM OUTSIDE YOUR SERVICE AREA USING EMERGENCY INTERCONNECTS

The affected utility would be receiving water temporarily until natural disaster has passed.

Water is delivered from outside your service area in such a manner that you can provide water at 20 psi to your distribution system during an extended power outage lasting more than 24 hours. This option **may** need to be combined with an additional option depending on if the entire water system will be receiving water from the interconnect. An affected utility opens one or more emergency interconnects with other water systems that can provide water into different pressure zones of the affected utility requesting to use this option.

If Using Emergency Interconnects (normally closed) to provide water to your service area:

- A. List water system(s) that will be providing your connections with water during an emergency, where the providing system obtains its water, and the number of connections that will be provided water.**

PWS ID Number and Name	Where does this system obtain its water?	Connections Served

DD. Provide the following information:

1. A map of your distribution system and highlight the area that will be provided water by a different water system.
2. Is the interconnect under direct pressure or is it an air gap into a storage tank? _____
3. Provide a copy of an agreement or contract that clearly states the providing system agrees to provide and maintain water to your distribution system at 20psi.

List storage tank(s) that have an air gapped interconnect?

Plant Name (Needs to match with listing under Section II of EPP)	Storage Tank(s)

EE. Will both water systems be using the same type of disinfection? ☐ YES ☐ NO

If you answered **NO** and the emergency source contains a different disinfectant than what the water system distributes under normal operations, provide the following information:

- ☐ YES ☐ NO Will the water system use only the emergency source during an emergency?
- ☐ YES ☐ NO Will the water system modify their distribution system to ensure areas with different disinfectants will be isolated from each other?
- ☐ YES ☐ NO Does the water system currently have a valid exception to blend chlorine and chloramines in an emergency?

FF. If the disinfection used is not the same for both water systems, explain how the water system will notify customers of the change for health purposes? [30 TAC §290.47(h)]

GG. **If only part of your system will have service maintained by interconnection, please provide information on what option applies to the rest of the system. Option _____ and complete that section of the EPP.**

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

HH. If water is delivered into a storage tank, please choose additional option(s) to ensure your utility can maintain 20 psi if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.

Please provide other option(s) then complete that section of the EPP.

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 10B: WATER IS DELIVERED TO YOUR DISTRIBUTION SYSTEM FROM OUTSIDE YOUR SERVICE AREA USING WATER HAULER(S)

The affected utility would be receiving water temporarily until natural disaster has passed. Water is delivered to your service area using a water hauler and, you can provide water at 20 psi to your distribution system during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option if the water system cannot deliver water pressurized to 20 psi to the distribution system.

If using Water Hauler(s) to provide water to your service area:

A. Provide documentation that the water hauler is approved and registered to haul water by the TCEQ.

Approved Water Hauler ID (Can be verified in Texas Drinking Water Watch)

II. List all water providers utilized by the water hauler and the type of disinfection used by each provider to ensure compatibility with disinfection protocols.

Water Provider ID	Type of Disinfection Used

JJ. Explain how the water will be pumped from the water hauler into the storage tank?

--

KK. Which storage tanks will be filled by the water hauler?

Plant Name (Needs to match with listing under Section II of EPP)	Storage Tank(s)

LL. Explain how the water will be pumped from the storage tank into the distribution system?

--

MM. Will the water hauler be able to supply enough water to the distribution system in a timely manner?

☐ YES ☐ NO

NN. If only part of your system will have service maintained by water hauling, please provide information on what option applies to the rest of the system.

Please provide option(s) and complete that section of the EPP.

OO. If water is delivered into a storage tank, please choose another option(s) to ensure your utility can maintain 20 psi if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

Please provide another option(s) then complete that section of the EPP.

OPTION 11: WATER SYSTEM HAS THE ABILITY TO PROVIDE WATER THROUGH ARTESIAN FLOWS

An affected utility can provide water using an approved artesian source to their distribution system at 20 psi during an extended power outage lasting more than 24 hours. This **will** need to be combined with another option if the water system is unable to ensure water is consistently treated and distributed at 20psi to your distribution system. It is the responsibility of the water system to plan for alternative sources of electric power should the water system be unable to consistently provide 20 psi of pressurized treated water to the distribution system.

A. Please provide the well identification number of the approved artesian source: TX_____

PP. What is the flow of the source in GPM? _____

QQ. _____ How will the source water get treated and distributed consistently to the distribution system?

RR. How will pumps be powered?

SS. Please choose other option(s) to ensure your utility can continuously treat, disinfect, and pressure your system to 20 psi, if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours. You may not be required to provide an additional option if it can document that your utility can continuously treat, disinfect, and pressure your system to 20 psi, if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.

Please provide another option(s) _____ then complete that section of the EPP.

OPTION 12: REDUNDANT INTERCONNECTIVITY BETWEEN PRESSURE ZONES

An affected utility opens valves in one or more of their pressure zones to provide water at 20 psi throughout its distribution system during an extended power outage lasting more than 24 hours. This option **may** need to be combined with another option to ensure the system can provide 20 psi throughout its distribution system.

- A. Explain how the water will flow to customers within one or more pressure zones, and how it will be replenished (with or without electricity)?**

TT. Please provide the following:

- ☐ A map of your system delineating pressure planes, and show elevated tanks, elevation contours of each zone and isolation valves.
- ☐ Provide useful storage of each elevated storage tank, see **(Option 9 Question C-D and Diagram page 25)**.
- ☐ A capacity report with details that show each pressure plane can provide 0.35 gpm per connection.
- ☐ Are there areas that will need inline booster pumps? If so, how will they be powered?
Please provide a schematic of the connection.

UU. Please choose other option(s) to ensure your utility can continuously treat, disinfect, and pressurize your system to 20 psi, if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.

Please provide your other option(s) _____ then complete that section of the EPP.

VV. A hydraulic study will be required if you are unable to demonstrate that your water system can maintain a minimum of 20 psi in distribution based on the information provided in Items A and B. For example, if elevation contour difference exceeds feet of useful storage or if water supply does not appear adequate for an electrical outage lasting more than 24 hours.

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 13: USE EMERGENCY WATER DEMAND RULES TO MAINTAIN EMERGENCY OPERATIONS

An affected utility will provide a minimum of 0.35 gallons per minute (gpm) per connection to the distribution system while maintaining distribution pressures of at least 20 psi in the event of the loss of normal power supply. This option **will** need to be combined with another option to ensure 20 psi during a water outage lasting more than 24 hours since just reducing water demand will not be adequate to provide water during an extended power outage.

- A. How will you communicate with your customers that you have instituted your Drought Contingency Plan during an extended power outage? (e.g., Utility website, Social Media, Radio, TV, reverse 911, door tags, signs posted at Subdivision entrances)**

WW. Please choose additional option to ensure your utility can maintain 20 psi if your electrical provider fails to provide your facility with power during an outage lasting longer than 24 hours.

Please provide other option(s) _____ then complete that section of the EPP.

XX. Explanation and Authority

During periods of drought, a major leak, a system failure, or excessive consumption beyond the capacity of the system, etc., the _____ (e.g. PWS name, owner name, owner representative, Operator, etc.) has the capability to conserve and restrict water use based upon the local water system regulations found in _____ (Drought contingency plan, rental agreement, city ordinance, etc.). During times of drought or other problems that limit the availability of water, public notice of water use restrictions will be issued by: _____ (e.g., PWS name, owner name, owner representative, operator, etc.).

YY. WATER RESTRICTION STAGES N/A ☐

Fill in the levels or stages of restrictions that will be applied, the conditions that generally will trigger them and the types of restrictions that will be applied. The conditions that trigger various restriction stages could be based upon critical source water levels and other conditions such as imminent loss of water or pressure.

Restriction Stage	Stage Trigger(s)	Restrictions
I		
II		
III		

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

OPTION 14: ANY OTHER ALTERNATIVE DETERMINED BY THE COMMISSION TO BE ACCEPTABLE

An affected utility can propose other alternatives of meeting the requirements of TWC 13.1394 if the alternative(s) ensure water will be provided at 20 psi throughout the distribution system during a water outage lasting more than 24 hours.

A. The following methods would NOT be acceptable options

i. Evacuation

The EPP must show how you will provide water during an extended power outage caused by a natural disaster, not during the disaster when it is unsafe. The rule specifically states the water is to be provided after it is safe and practicable. The people who are evacuated may return when it is safe to do so after the disaster has passed, but before power is returned to your water system. In the case, of the most recent winter storm power was not restored for several days. You must be able to provide water after the disaster, but before normal power is restored.

ii. Providing bottled water

The EPP must show how you will provide water at **20 psi** at each of your customer's connections.

iii. Relying on your provider **without the documentation that states the provider will provide your system with 20psi throughout your distribution system.**

ZZ. Alternative Description

Describe the alternative and how it will provide 20 psi throughout your distribution system:

Section V – Emergency Communications

Emergency Communications are an essential part of an emergency response event. Knowing who to notify before an emergency event occurs is the best way to ensure that you, your system, and your customers receive needed emergency assistance. Many numbers have been provided to assist you with completing this portion of the plan. Please feel free to make copies of the pages in Section IV to post at your facility and/or to train your employees.

If the Organization is not applicable to your utility, please enter **N/A**. You are required to provide phone numbers for your County Judge and County Sheriff's Office.

If you are a member of another mutual aid organization other than TXWARN please include them on this list.

A. Emergency Contacts

Organization	Phone Numbers (include area code)		E-Mail or Website
	Day	Evening	
Fire Department	911	911	fairmountfirerescue@gmail.com
Police Department	911	911	http://www.co.sabine.tx.us
Emergency Medical Service	911	911	http://sabinecountyems.org
TCEQ Water Homeland Security	888/777-3186	888/777-3186	homeland@tceq.texas.gov
Texas PUC	512/936-7405		http://www.puc.texas.gov/industry/water/utilities/fmt.aspx Email: water@puc.texas.gov
National Response Center	800/424-8802	800/424-8802	http://nrc.uscg.mil/Default.aspx
State Spill Hotline	800/832-8224	800/832-8224	https://www.tceq.texas.gov/response/spills
Poison Control	800/222-1222	800/222-1222	http://poisoncontrol.org/home/
CHLOREP (Chlorine Emergency Plan)	800/424-9300	800/424-9300	https://www.chlorineinstitute.org/emergency-preparedness/chlorep/
TCEQ Regional Office	24-hour cell phone 512/965-2717		Website: https://www.tceq.texas.gov/agency/directory/region/reglist.html
County Judge	409-787-3543		Email: cookie.cryer@co.sabine.tx.us Website:
County Office of Emergency Management		409-787-5241	Email: Website: http://co.sabine.tx.us/page/sabine.emergency
County Sheriff's Office	409-787-2266		Email: http://co.sabine.tx.us/page/sabine.sheriff Website:
County Public Health & Environmental Services	409-746-3284		Email: esd.sratx.org Website:
City Mayor's Office	409-787-2251		Email: cityhall@cityofhemphill.com Website:

CONFIDENTIAL
Not subject to disclosure under Chapter 552, Government Code

Local Public Health & Environmental Services	409-746-3284		Email: esd@sratx.org Website:
Local Office of Emergency Management	409-787-3570	409-787-5241	Email: Website: http://co.sabine.tx.us/page/sabine.emergency
TX Division of Emergency Management (TDEM)	Provides list of State and District Coordinators which assist local officials with state assistance requests. Requests must start at local level first.		https://tdem.texas.gov/field-response/
TXWARN	866/9-TXWARN (866/989-9276)		Email: info@txwarn.org https://www.txwarn.org
Other Mutual Aid Provider			Email: Website:

AAA.

Local Contact Notification List

Identify those entities that should be notified in the event of an extended power outage requiring emergency operations. These are people who you provide water to that you may need to contact during an emergency.

Organization	Contact Name	Title	Phone Numbers (include area code)			E-Mail
			Day	Evening	Cellular/Pager	
Other Local Government Officials						
Hospitals served by the Affected Utility						
Nursing Homes served by the Affected Utility						
Pharmacies						
Priority Water Users (Those that are critically dependent upon water including schools, dialysis centers, institutions, individuals with special needs, businesses, and other interconnected water systems, etc.)						
Others						

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

BBB.

Chemical Supplier Information

Identify your Chemical Suppliers. You may need to contact them for more chemicals during an emergency

Chemical	Supplier	Contact Name	Phone Number Day	Phone Number Evening	Cell Phone	E-Mail

CONFIDENTIAL
Not subject to disclosure under Chapter 552, Government Code

CCC.

Certified Laboratory Information

Identify your laboratory and a backup laboratory. You may need a backup laboratory if your lab is nonfunctional.

Organization	Contact Name	Title	Phone Numbers (include area code)			E-Mail
			Day	Evening	Cellular/Pager	
SABINE RIVER AUTHORITY, ORANGE TX	POLLIE HOLTHAM	DIVISION MANAGER	409-746-3284			ESD@SRATX.ORG

DDD.

Fuel Supplier Contact Information (if applicable)

Identify your Fuel Suppliers. You may need to contact them for fuel during an emergency

Fuel Type	Supplier	Contact Name	Phone Number Day	Phone Number Evening	Cell Phone	E-Mail
PROPANE	SANDIFERS LP		409-963-1269			contactus@sandiferslp.com

EEE.

Utilities Contact Information

Identify your Utilities Contacts. You may need to contact them during an emergency and use **N/A** if a listed organization does not apply to your water system.

Organization	N/A	Contact Name	Title	Phone Numbers (include area code)			E-Mail
				Day	Evening	Cellular/Pager	
Electric Utility Company		DEEP EAST TEXAS		800-392-5986			POWER@DEEPEAST.COM
Gas Utility Company							
Sewer Utility Company							
Telephone Utility Company		WINDSTREAM		800-392-5986			
Wholesale Water Provider							
Wholesale Water Provider							
Other							

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

FFF.

Bulk Water Suppliers

Identify any bulk or bottled water suppliers that you might utilize in an emergency.

Organization	Contact Name	Title	Phone Numbers (include area code)			E-Mail
			Day	Evening	Cellular/Pager	
Bulk Water Haulers						
Bottle Water Sources						

GGG.

Media Notification List

Identify the media organizations that you might need to contact to provide information to your customers. Also identify who is your media spokesperson. If you have a different method to communicate to your customers, please list under **Other**.

Organization	Contact Name	Title	Day	Evening	Cellular/Pager	E-Mail
Designated Water System Spokesperson	BILLY MANLEY	GENERAL MANAGER			409-659-8941	BM5541@YAHOO.COM
Newspaper - Local	SABINE COUNTY REPORTER		09-787-2172			SCREPORTER@YAHOO.COM
Newspaper – Regional State						
Radio						
Television						
Other						

CONFIDENTIAL
Not subject to disclosure under Chapter 552, Government Code

ATTACHMENT A – SUBMITTING COMPLETED EPP

Upon completing your EPP please email or mail (**not both**) the completed form and additional documentation needed to the Texas Commission on Environmental Quality for review and approval to:

Choose One

PDWEPP@tceq.texas.gov

OR

Water Supply Division, Emergency Preparedness and Response Section, MC-155
P.O. Box 13087
Austin, TX 78711-3087

Assistance

If you need assistance with completing the EPP template, please fill out the **EPP Help Form** at www.tceq.texas.gov/goto/epp-help and TCEQ will contact you via email or phone to provide assistance.

Approved Plan Distribution

Complete this section after the approval letter is received from TCEQ. Please maintain appropriate documentation of compliance with plan distribution requirements. In addition, a copy of the approved plan must be maintained by the "affected utility", so that it can be easily accessed in the event of an emergency. All employees must receive annual training on implementation of the plan.

Copies of the approved Emergency Preparedness Plan and the TCEQ Approval Letter must be distributed to the following entities:

Distributed To	Method of Distribution	Date
County Judge		
County Office of Emergency Management		
Public Utility Commission Filing	Use the weblinks provided: For Confidential filing procedures for the PUC use Docket No. 52272 1. <u>http://puc.texas.gov/industry/filings/Confidential.aspx</u> For PUC Procedural Rules for Filing of Pleadings, Documents, and Other Materials 2. <u>http://puc.texas.gov/agency/rulesnlaws/procrules/pr-e/22.71/22.71.pdf</u> Address: Public Utility Commission of Texas Central Records 1701 N Congress PO Box 13326 Austin, Texas 78711-3326	


CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

	For additional questions contact the PUC Central Records office at (512)936-7180.	
Texas Division of Emergency Management (TDEM)	Submit to TDEM via email at: soc@tdem.texas.gov Address: Texas Division of Emergency Management Attn: State Operations Center 1033 La Posada, Ste 300 Austin, Texas 78752 For additional questions contact the TDEM (512)424-2208	

ATTACHMENT B – Generator Information

If you plan on utilizing options 1, 2, 4, 5, or 6, you will need to estimate the gallons per hour of fuel that will be used by the generator. This is essential in determining the volume of fuel required to maintain emergency operations. Below is a chart from the FEMA Resource Typing Manual which may be of assistance in determining fuel needs and generator types.
Supplemental information only.

RESOURCE: GENERATORS						
Category:	Public Works & Engineering (SEF 3)			Kind:	Equipment	
Minimum Capabilities:	Type I		Type II	Type III	Type IV	Type V
Component	Metric					
Equipment	KW	XQ2000 2000 kW Generator; Sound attenuated; Trailer mounted (semi tractor); Up to 3015 Amps@ 480 Volts, 3 Phase, 60 Hz; Dry weight 89,000 lbs; Fuel tank capacity 1250 Gallons; Dimensions 40' Long x 8' Wide x 13.5' Tall; Potential application example—Single or multiple units for: Power plants, heavy industrial facility, high-rise buildings; Setup time (cables from generator to main power feed estimated at 5+ hours)	XQ1500 1500 kW Generator; Sound attenuated; Trailer mounted (semi tractor); Up to 2260 Amps@ 480 Volts, 3 Phase, 60 Hz; Dry weight 59,000 lbs; Fuel tank capacity 1250 Gallons; Dimensions 40' Long x 8' Wide x 13.5' Tall; Potential application example—Single or multiple units for: Universities, hospitals, medium to large manufacturing facility; Setup time (cables from generator to main power feed estimated at 5+ hours)	XQ600 600 kW Generator; Sound attenuated; Trailer mounted (semi tractor); Up to 2080 Amps@ 208 Volts, 3 Phase, 60 Hz / up to 902 Amps@ 480 Volts 3 Phase, 60 Hz; Dry weight 37,000 lbs; Fuel tank capacity 660 Gallons; Dimensions 40' Long x 8' Wide x 13.5' Tall; Potential application examples: Retail stores, HVAC system power, multi-story/buildings, light manufacturing, apartment buildings; Setup time (cables from generator to main power feed estimated at 3+ hours)	XQ400 400 kW Generator; Sound attenuated; Trailer mounted (pull behind); Multi-voltage distribution panel; Up to 1390 Amps @ 208 Volts, 3 Phase, 60 Hz/up to 602 Amps@ 480 Volts 3 Phase, 60 Hz; Dry weight 16,800 lbs; Fuel tank capacity 470 Gallons; Dimensions 23' Long x 8' 5" Wide x 11' Tall; Potential application example: Large office building, public schools, libraries, and communication equipment; Setup time (cables from generator to main power feed estimated at 2+ hours)	XQ125 125 kW Generator; Sound attenuated; Trailer mounted (pull behind); Multi-voltage distribution panel; Up to 433 Amps@ 208 Volts, 3 Phase, 60 Hz / up to 188 Amps @ 480 Volts 3 Phase, 60 Hz; Dry weight 10,610 lbs; Fuel tank capacity 223 Gallons; Dimensions 18' 5" Long x 6' 5" Wide x 9' Tall; Potential application example: Small office building, emergency mobile trailers & operations, restaurants; Setup time (cables from generator to main power feed estimated at 1 hour)
Comments:	2500-gallon external fuel tanks available. Fuel consumption is estimated at 7% of the kW usage (example: fuel consumption on a 100 kW Generator operating at full load is approximately 7 gallons per hour). Technicians are available for hookup and monitoring of equipment. 4/0 Quick connect (Cam-Lock) cable is available for tie-in to power feed, rated at 400 Amps each cable. Fuel supply, and/or fuel vendors available. Power distribution equipment available. Transformers & Load Banks are available.					
		XQ2000	XQ1500	XQ600-400	XQ125	
						
						

ATTACHMENT C – RECOVERY CHECKLIST – Supplemental Information Only

Returning to normal operations is vital to rapid restoration of clean, safe water to the community and is essential to the assessment and recovery process. The following is a checklist of actions to be taken during the recovery period. Also included is a preliminary damage assessment that can be used to assist in the recovery process.

Assessment and Recovery Period Checklist

- ☐ Perform in-depth damage assessment of system to determine long-term effects of damaged areas (use assessment form below).
- ☐ Notify TCEQ of system operational status and situation.
- ☐ Will there be a need to use mutual aid agreements and/or implement standby contracts or other emergency agreements for equipment and operations?
- ☐ Prepare written documentation of emergency work performed for possible compensation by emergency agencies. Make sure that crews make a record of work effort, written logs (see Work Order Log) and take pictures. This will all be helpful in recovery of funds.
- ☐ Notify appropriate insurance carriers. Provide written and photo documentation of damage.
- ☐ Assist in the survey of emergency repairs and scheduling of permanent repairs.
- ☐ Servicing of emergency equipment, when able (oil changes, lubrication, etc.).
- ☐ Make sure the public is kept informed throughout the extent of the emergency.

Preliminary Damage Assessment

Following the Damage Assessment, you should notify TCEQ of your operational status.

A.

A. General Overview:

- ☐ Determine need to repair, replace, or abandon facilities
- ☐ Estimate cost to repair damage
- ☐ Evacuate buildings in danger of collapse

HHH.

Treatment Plants:

- ☐ Check if power is available and condition of mechanical and electrical equipment
- ☐ Check for chemical spills or releases

III. Confirm that field crew does the following:

- ☐ Check for structural damage
- ☐ Closes and tags damaged facilities and equipment

JJJ.

Tanks:

- ☐ Check for evidence of failure of subbase

KKK.

Reservoirs:

Check for:

- ☐ Leaks and Seepage
- ☐ Cracks
- ☐ Broken inlet/outlet pipes, underdrains
- ☐ Landslides or Embankment slump
- ☐ Buckling

LLL.

Distribution System:

Check for:

- ☐ Leaks
- ☐ Breaks
- ☐ Pressure loss in lines
- ☐ Cross-connections
- ☐ Check mechanical couplings

CONFIDENTIAL

Not subject to disclosure under Chapter 552, Government Code

☐ Lower water levels to reduce possibility of structural damage

MMM.

Wells:

- ☐ Check for physical damage to facilities
- ☐ Test for contamination
- ☐ Name, address, phone # for private lab
- ☐ Check for pump or motor failure
- ☐ Check power source

ATTACHMENT D – State Assistance Request (Supplemental Information Only):

If an affected utility is interested only in mutual aid assistance, register with TXWARN at <https://www.txwarn.org/>; this is a free service.

When requesting state assistance, the request(s) must start at the local level with the County Judge or the County Emergency Manager. The request must go to the Texas Division of Emergency Management using the steps outlined in the STAR Process.

